

MiCOM Alstom P14x

Feeder management relays

Your search for a single box feeder management relay ends with MiCOM P14x



CUSTOMER BENEFITS

- 1 A and 5 A in same relay
- Wide auxiliary supply voltage range
- Programmable function keys (P145)
- Flexible LED indication (P145)
- Multiple communications protocols and interfaces, including IEC 61850
- Customisable menu
- Redundant communications with zero downtime using optional PRP technology

An integrated solution for the complete protection, control and monitoring of overhead lines and underground cables from distribution to transmission voltage levels

The wide range of auxiliary functions provides the user with sufficient information to efficiently maintain the power system and its components, including circuit-breakers, CTs, VTs, etc.

A customisable, friendly, multi-lingual user interface and programmable graphical scheme logic allow simple and flexible applications on any network. In addition, the P145 has integrated user function keys and tri-colour programmable LEDs, which provide a cost-effective solution for full feeder scheme applications.

Simply combine the P145 relay with a P891 (trip/close module) and P991 (test block) in a frame and you have a complete 19" rack mounted feeder scheme. Use the function keys to replace control scheme switches and save on engineering time and wiring costs.

With optional High Speed - High Break contacts, the high break performance ensures no burn-out of contacts during normal operations or situations such as breaker failure or defective CB auxiliary contacts. The need for external electromechanical trip relays can be reduced/removed by transferring the high rating and durability duties to the MiCOM device, thus providing further application and cost benefits.

Connecting the relay to virtually any kind of substation automation system or SCADA is made possible by the wide range of updated communications protocols, including IEC 61850.

A range of hardware interfaces are available for easy integration into any new or legacy system.

MiCOM Alstom P40 series extends the IEC 61850-8-1 station bus to include Parallel Redundancy Protocol (PRP), which offers a vendor-interoperable solution to implement redundant communications. It has the advantage of taking zero time to recover from a failure, as parallel alternative paths are continually operative. This compares to 25 ms or more healing time for legacy techniques such as Rapid Spanning Tree Protocol (RSTP).

PROTECTION FUNCTIONS OVERVIEW

IEC 61850			P141	P142	P143	P145
50/51/67	OcpPTOC/RDIR	Directional / non-directional, instantaneous / time delayed phase overcurrent (6 stage)	-	-	-	-
50N/51N/67N	EfdPTOC/EfmPTOC	Directional / non-directional, instantaneous / time delayed, measured earth fault (4 stage)	-	-	-	-
67N	SenEftPTOC	Sensitive directional earthfault (SEF/ I Cos I Sin) (4 stage)	-	-	-	-
67W	SenEftPTOC	Wattmetric earthfault	-	-	-	-
YN		Neutral admittance protection	-	-	-	-
64	SenRefPDIF	Restricted earthfault	-	-	-	-
		Blocked overcurrent	-	-	-	-
		Selective overcurrent	-	-	-	-
		Cold load pick-up	-	-	-	-
51V		Voltage controlled overcurrent	-	-	-	-
51R		Voltage restrained overcurrent	-	-	-	-
46	NgcPTOC	Directional / non-directional negative sequence overcurrent	-	-	-	-
49	ThmPTTR	RMS thermal overload (single / dual time constant)	-	-	-	-
37P / 37N		Phase and neutral undercurrent	-	-	-	-
27	VtpPhsPTUV	Undervoltage (2 stage)	-	-	-	-
59	VtpPhsPTOV	Overvoltage (2 stage)	-	-	-	-
59N	VtpResPTOV	Residual overvoltage (neutral displacement) (2 stage)	-	-	-	-
47	NgvPTOV	Negative sequence overvoltage	-	-	-	-
81U	PTUF	Underfrequency (9 stage) - Advanced	-	-	-	-
81O	PTOF	Overfrequency (9 stage) - Advanced	-	-	-	-
81R	PFRC	Rate of change of frequency protocol (9 stage) - Advanced	-	-	-	-
81RF		Frequency supervised rate of change of frequency (9 stage) - Advanced	-	-	-	-
81RAV		Average rate of change of frequency (9 stage) - Advanced	-	-	-	-
		Freq. based load restoration (9 stage) - Advanced	-	-	-	-
		Rate of change of voltage protection (2 stage)	-	-	-	-
BC		Broken conductor (open jumper)	-	-	-	-
50BF	RBRF	Circuit-breaker failure	-	-	-	-
VTS		Voltage transformer supervision (1, 2 & 3-phase fuse failure detection)	-	-	-	-
CTS		Current transformer supervision	-	-	-	-
49SR		Silicon rectifier overload protection	-	-	-	-
79	RREC	4 shot three-pole auto reclose	-	-	-	-
25	RSYN	Check synchronising	-	-	-	-
	2nd Harm Block	2nd harmonic blocking	-	-	-	-
32R/32L/32O		Phase segregated power	-	-	-	-
		Sensitive power	-	-	-	-
	FnkGGIO	Function keys	-	-	-	10
	LedGGIO	Programmable LEDs (tri-colour)	-	-	-	18
	OptGGIO	Digital inputs (maximum) *	8	16	32	32
	RlyGGIO	Output relays (maximum) (Hi Break - Hi Speed option available)*	8	15	32	32
		Front communications port (RS232)	-	-	-	-
		Rear communications port (RS485/Optic/Ethernet) *	-	-	-	-
		Second rear communications port (RS232/RS485) *	Option	Option	Option	Option
		Time synchronisation port (IRIG B modulated/un-modulated) *	Option	Option	Option	Option
		InterMiCOM teleprotection for direct relay - relay communication EIA(RS) 232 for MODEM links up to 19.2 kbit/sec	Option	Option	Option	Option

* It may not be possible to get all in one particular model, refer data sheet for model sale

APPLICATION

The MiCOM ALSTOM P14x range is suitable for all applications where overcurrent protection is required. It is suitable for solidly earthed, impedance earthed, Petersen coil earthed and isolated systems.

The first application shows a parallel transformer protection where the P141 replaces many of the discrete protection elements normally associated with the LV side of the transformer. The protection includes non-directional and directional phase overcurrent and earth fault, restricted earth fault and circuit-breaker failure protection. The second application shows a P143 protecting a plain feeder using phase overcurrent, sensitive earth fault, negative sequence overcurrent, thermal protection and breaker failure protection. The integral autorecloser with check synchronising can be configured to grade with downstream reclosers.


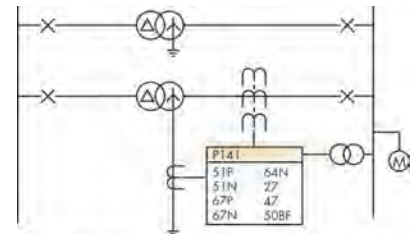


Figure 3: Typical parallel transformer application

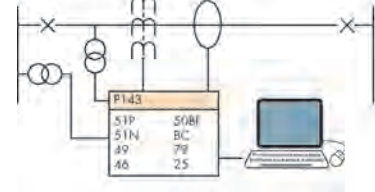

Typical applications of P14x


The P145 relay is especially suitable where a complete scheme solution is required and comprises function keys for integral scheme control functionality. The application shows the P145 combined with the P891 and P991 to provide a complete feeder scheme solution. The P891 provides relay independent tripping and closing functionality where required. This functionality can also be integrated with the P145 to make use of relay functions such as check synchronising or autoreclosing.

MANAGEMENT FUNCTIONS

In addition to the wide range of protection functions listed in the table, all relays in the P14x range are provided with the following measurement, control, monitoring, post fault analysis and self-diagnostic functions.

- Measurement of all instantaneous & integrated values
- Circuit-breaker control, status & condition monitoring
- Trip circuit and coil supervision
- 4 alternative setting groups
- Control inputs
- Fault locator

- Programmable scheme logic
- Programmable allocation of digital inputs and outputs
- Sequence of events recording
- Comprehensive disturbance recording (waveform capture)
- User configurable LEDs
- Local and remote communications ports
- Multiple communications protocol and interface options
- Time synchronisation
- Fully customisable menu
- Multi-level password protection
- Power-up diagnostics and continuous self-monitoring of relay
- User-friendly settings and analysis software
- Read-only mode
- Enhanced opto input time stamping
- Enhanced check sync. feature

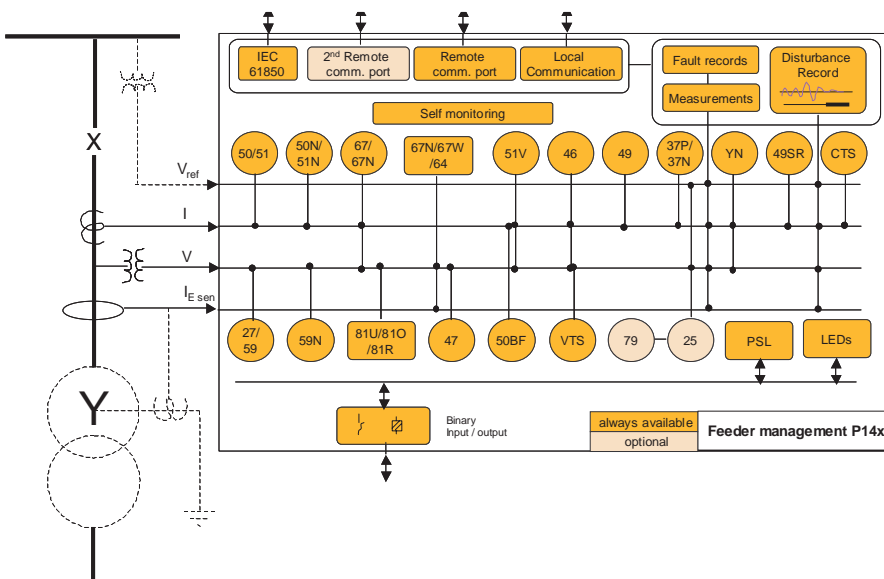


Functional overview
(See Protection Functions Overview for description of ANSI codes)

PHASE OVERCURRENT

Six independent stages are available for each phase overcurrent element. Each stage may be selected as non-directional or directional (forward/reverse). All stages have definite time delayed characteristics and three of the stages may also be independently set to one of ten IDMT curves (IEC and IEEE). Feeder Manager supports the User Programmable Curve Tool (UPCT) available on the S1 Agile web site. The tool can be used to provide customised Operate/Reset curves, providing additional flexibility and allowing the use of the total feeder capacity with complete protection. If a standard curve is not suitable for the application, the user can program and upload a customised curve to the relay.

The IDMT stages have a programmable reset timer for grading with electro-mechanical relays, to reduce autoreclose dead times and to reduce clearance times where intermittent faults occur.

The phase fault directional elements are internally polarised by quadrature phase-phase voltages and will make a correct directional decision down to: 0.5 V ($V_n = 100 - 120$ V) or 2.0 V ($V_n = 380 - 480$ V). A synchronous polarising signal is maintained for 3.2s after voltage collapse to ensure that the instantaneous and time delayed overcurrent elements operate correctly for close-up 3-phase faults.

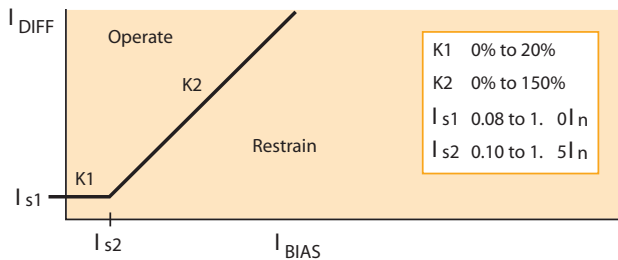

REF biased differential characteristics

STANDARD EARTH FAULT

There are two standard earth fault elements, each with four independent stages:

- The first element operates from measured quantities - Earth fault current which is directly measured using a separate CT, or residual connection of the three line CTs.
- The second standard earth fault element operates from a residual current that is derived internally from the summation of the 3-phase currents.

All earth fault elements have the same directionality and IDMT characteristics as the phase overcurrent element. Both earth fault elements may be enabled at the same time providing directional earth fault protection and back-up standby earth fault protection in the same device. The directionality of the earth fault elements is provided by either residual voltage or negative sequence voltage.

SENSITIVE EARTH FAULT

A core balance CT should be used to drive the sensitive earth fault function. The directionality of the sensitive earth fault element is provided by the residual voltage.

WATTMETRIC

As an alternative to the directional earthfault characteristic, a directional $I \cos$ characteristic can be used for Petersen coil earth fault protection using the sensitive earth fault input. A directional $I \sin$ characteristic is also available for the protection of insulated feeders.

BLOCKED OVER CURRENT


Each stage of overcurrent and earth fault protection can be blocked by an optically isolated input. This enables overcurrent and earth fault protection to integrate into a blocked overcurrent busbar protection scheme.

COLD LOAD PICK-UP LOGIC

Cold load pick-up temporarily raises the overcurrent settings following closure of the circuit-breaker, allowing the protection settings to be set closer to the load profile.

RESTRICTED EARTH FAULT

The restricted earth fault protection provided for protection of transformer windings against earth faults may be configured as either high impedance or low impedance biased differentials.

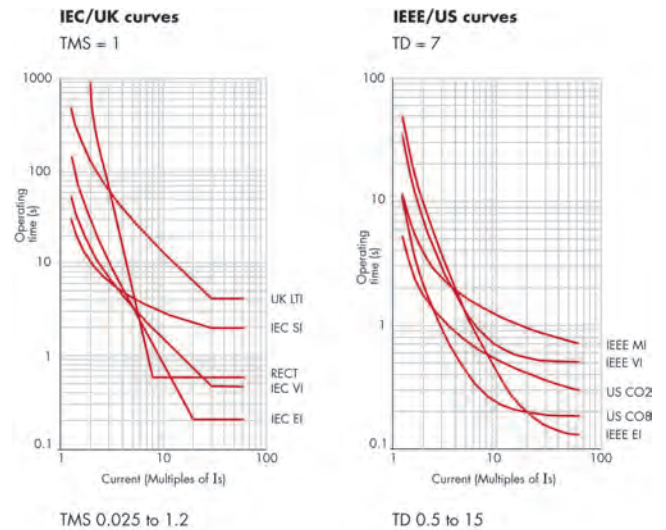

Choice of IDMT characteristics

Features carefully designed to protect any type of system

2ND HARMONIC BLOCKING

The 2nd harmonic blocking detects high inrush current inflows that occur when transformers or machines are connected. The function will block the phase overcurrent, earth fault, sensitive earth fault and negative sequence overcurrent.

VOLTAGE CONTROLLED OVERCURRENT / VOLTAGE RESTRAINED OVERCURRENT


In order to provide backup protection for phase faults, an element is included which can be set as either voltage controlled overcurrent or voltage restrained overcurrent. The timing characteristic can be set as either definite time or IDMT.

NEGATIVE SEQUENCE OVERCURRENT

Negative sequence overcurrent protection can be set as either non-directional or directional (forward /reverse) and can operate for remote phase-phase and phase earth faults even with delta-star transformers present.

RMS THERMAL OVERLOAD

Thermal overload protection provides both alarm and trip stages. The thermal element may be set with either a single time constant characteristic for the protection of cables or dry transformers, or a dual time constant characteristic to protect oil-filled transformers. In the event of loss of auxiliary supply, the thermal state is stored in non-volatile memory.

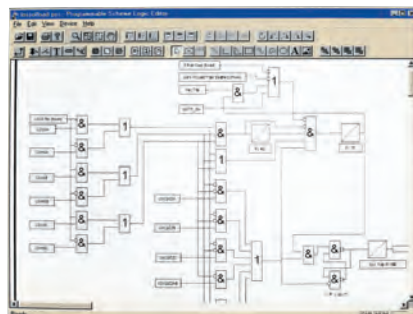

Programmable scheme logic editor (S1 Studio)

UNDER / OVERVOLTAGE & RATE OF CHANGE OF VOLTAGE

Under/overvoltage protection may be configured to operate from either phase-phase or phase-neutral quantities. Two independent stages with definite time elements are available, one of the stages can also be configured to an inverse characteristic. Two stages of rate of change of voltage protection elements are also available, which can be set independently.

RESIDUAL OVERVOLTAGE

Residual overvoltage protection is available for detecting earth faults in high impedance earthed or isolated systems. The neutral voltage is derived from the 3-phase voltage inputs. Two independent measuring elements with definite time characteristics are available and one of the elements can also be configured to have an inverse characteristic.

FREQUENCY

Nine stages each of: overfrequency, underfrequency, rate of change of frequency, frequency supervised rate of change of frequency, average rate of change of frequency, frequency based load shedding during severe system disturbances.

BROKEN CONDUCTOR

The broken conductor protection detects unbalanced conditions caused by broken conductors, maloperation of single phase of switchgear or by single phasing conditions. It operates on the ratio of I2 to I1.

PHASE SEGREGATED POWER

Two stages of power protection are provided and each stage can be independently configured to operate as overpower or underpower and forward or reverse direction. The relays provide a standard 3-phase power protection element and also a single-phase power protection element.

SENSITIVE POWER

Two stages of sensitive power protection are provided and these can be independently selected as reverse power, overpower, low forward power or disabled depending on the operating conditions.

LOAD ENCROACHMENT

Load encroachment (load blinder), an impedance based feature avoids tripping for heavy load flows.

VOLTAGE TRANSFORMER SUPERVISION

Voltage transformer supervision is provided to detect loss of one, two or three VT signals, providing indication and inhibition of voltage dependent protection elements. An optically isolated input may also be configured to initiate the voltage transformer supervision alarm and blocking when used with MCBs or other external forms of voltage transformer supervision.

CURRENT TRANSFORMER SUPERVISION

Current transformer supervision is provided to detect loss of phase CT signals and inhibit the operation of current dependent protection elements.

PROGRAMMABLE SCHEME LOGIC

Programmable scheme logic allows the user to customise the protection and control functions. It is also used to program the functionality of the optically isolated inputs, relay outputs and LED indications. The programmable scheme logic comprises gate logic and general purpose timers. The gate logic includes OR, AND and majority gate functions, with the ability to invert the inputs and outputs and provide feedback. The programmable scheme logic is configured using the graphical S1 Agile PC-based support software.

FUNCTION KEYS (P145)

Ten function keys are available for scheme control functionality. The function keys operate in two modes, normal and toggled. They activate associated signals in PSL that can easily be used to customise the application. The following examples illustrate how scheme functionality can easily be implemented for use with the function keys:

- Remote CB control enable/disable
- Auto-reclose enable/disable
- Sensitive earth fault enable/disable
- Auto-reclose lockout reset

Each function key has an associated tri-colour LED (red, green, yellow) providing a clear indication of the associated function's state.

INDICATION (P145)

Eighteen tri-colour LEDs are available for user programming. The LED colours (red, green or yellow) are driven via digital databus signals in PSL and can be programmed to indicate up to four conditions/states, for example:

- Off -Not in service
- Red -CB closed
- Green -CB open
- Yellow -CB not healthy

CIRCUIT BREAKER FAILURE PROTECTION

Two-stage circuit-breaker failure protection may be used for tripping upstream circuit-breakers and for re-tripping the local circuit-breaker if required. The circuit-breaker failure logic may also be initiated externally from other protection devices if required. The undercurrent elements used in the CB fail reset mechanism have been enhanced to detect the breaker opening in real-time, even when there are subsidence currents in the CT secondary caused by the remnant flux.

CIRCUIT BREAKER CONTROL

Circuit-breaker control is available from the front panel user interface, optically isolated inputs and remotely via the substation communications.

AUTORECLOSE WITH CHECK SYNCHRONISING

The P142 and P143 provide three-pole multi-shot autoreclose. The user may select a single, two, three or four shot autoreclose cycle, with independently settable dead times and reclaim time. Autoreclose can be initiated from the internal protection elements or from external protection via an opto input. Advanced features include live line working and sequence coordination (co-ordination with downstream reclosing equipment). The P143 also includes check synchronisation.

MEASUREMENT AND RECORDING FACILITIES

The P14x series is capable of measuring and storing the values of a wide range of quantities. All events, fault and disturbance records are time tagged to a resolution of 1 ms using an internal real-time clock. An optional IRIG-B port is also provided for accurate time synchronisation. A lithium battery provides backup for the real-time clock and all records in the event of auxiliary supply failure. This battery is supervised and easily replaced from the front of the relay.

MEASUREMENTS

The measurements provided, which may be viewed as primary or secondary values, can be accessed via the back-lit liquid crystal display, or the communications ports. A wide range of instantaneous and integrated parameters are available. The list includes measured signals like phase currents and voltages and computed signals like power, frequency, energy, etc. Phase currents and phase to neutral voltages are available in true rms and fundamental quantities. Phase notation is user definable using the MiCOM ALSTOM S1 text editor.

FAULT LOCATION

A fault location algorithm provides distance to fault in miles, kilometres, ohms or percentage of line length.

EVENT RECORDINGS


Up to 512 time-tagged event records are stored in battery-backed memory and can be extracted using the communications ports or viewed on the front panel display.

DISTURBANCE RECORDS

The internal disturbance recorder has 8 analogue, 32 digital and 1 time channel. Approximately 50 records of 0.5 s duration can be stored. All channels and the trigger source are user configurable. Disturbance records can be extracted from the relay via the remote communications and saved in the COMTRADE format. These records may be examined using S1 Agile or any suitable software program.

TRIP CIRCUIT SUPERVISION

Supervision of the trip circuit in both circuit-breaker open and closed states can be realised using the optically isolated inputs and programmable scheme logic.

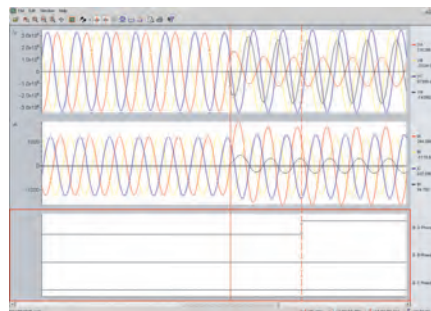

Programmable scheme logic editor (S1 Agile)

FAULT RECORDS

Records of the last 5 faults are stored in battery-backed memory.

The information provided in the fault record includes:

- Indication of faulted phase
- Protection operation
- Active setting group
- Date and time
- Fault location
- Relay and CB operating time
- Currents, voltages and frequency

CIRCUIT BREAKER CONDITION MONITORING

The circuit-breaker condition monitoring features include:

- Monitoring the number of breaker trip operations
- Recording the sum of the broken current quantity Ix, 1.0 x 2.0
- Monitoring the breaker operating time
- Fault frequency counter

LOCAL AND REMOTE COMMUNICATIONS

Two communications ports are available as standard: a rear port providing remote communications and a front port providing local communications.

The front RS232 port has been designed for use with S1 Agile, which fully supports functions within the relay by providing the ability to: program the settings off-line, configure the programmable scheme logic, extract and view events, disturbance and fault records, view the measurement information dynamically and perform control functions.

The default remote communications are based on RS485 voltage levels. Any of the protocols listed below can be chosen at the time of ordering:

- Courier / K-bus
- Modbus
- IEC60870-5-103 (optical interface also available)
- DNP 3.0
- IEC 61850 (over 100 Mbit/s, fibre/copper Ethernet)

DIFFERENT COMMUNICATIONS INTERFACES

IEC 61850 is available when the optional Ethernet port is ordered. IEC 61850 offers high-speed data exchange, peer-to-peer communications, reporting, disturbance record extraction and time synchronisation. Redundant Ethernet is also available in various options (self healing ring, RSTP and dual homing star). The P14x has 128 virtual inputs with an improved GOOSE performance.

An optional second rear courier port is available, which may be configured as RS232, RS485 or K-Bus.

DIAGNOSTICS

Automatic tests performed, including power-on diagnostics and continuous self-monitoring, ensuring a high degree of reliability. The results of the self-test functions are stored in battery-backed memory. Test features available on the user interface display input quantities and the states of the digital inputs and relay outputs. A local monitor port provides digital outputs, selected from a prescribed list of signals, including the status of protection elements. These test signals can also be viewed using the communications ports and front panel user interface.


HARDWARE

All models in the P14x series include:

- A back-lit liquid crystal display
- 12 LEDs (8 programmable)
- An optional IRIG-B port
- An RS232 port & an RS485 port
- An optional RS232/RS485/K-Bus port
- An optional Ethernet port for IEC 61850 protocol
- A download/monitor port
- A battery (supervised)
- N/O and N/C watchdog contacts
- 1 A/5 A dual rated CTs

Expansion cards are available to increase the number of digital inputs and outputs for the P142 and P143. Also, depending on the relay model, up to eight High Speed-High Break contacts are available as an option. This will protect against burnt contacts due to a stuck breaker or defective breaker auxiliary contact conditions.

The optically isolated inputs are independent. The relay outputs may be configured as latching or self reset. All CT connections have integral shorting.

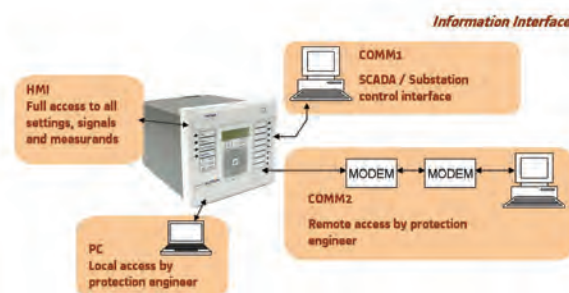

P14x provides up-to-date and versatile communications options

Alstom device track record

- KCGG/KCEG - First numerical overcurrent relay launched in 1993, with over 20 000 units sold
- P14x series introduced in 1999. Worldwide application, with over 100 000 units delivered
- Introduction of phase II hardware of P14x in 2002
- Addition of UCA2 protocol and Ethernet port in 2004
- Addition of IEC 61850 protocol in 2006

MiCOM P40 AGILE

Alstom's philosophy is one of continuous improvement in our products and solutions. Our emphasis on communications in MiCOM has become a focus which secures our leadership in digital substations. To mark this phase of evolution, the brand "P40 Agile" is applied to the range. P40 Agile is a mark of performance and quality, proudly available from Alstom.

For more information
please contact Alstom Grid:

Alstom Grid Worldwide Contact Centre
www.alstom.com/grid/contactcentre/

Phone: +44 (0) 1785 250 070

Visit us online: www.alstom.com